


Energy Audit Report
of
Progressive Education Society's
Modern College of Arts, Science & Commerce
Ganeshkhind, Pune 411 016

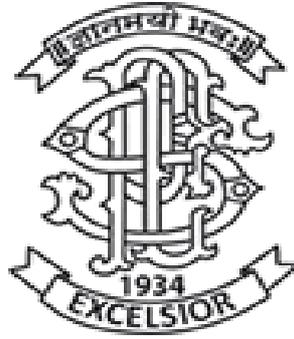

Year: 2018-19

Prepared by

Enrich Consultants,
Yashashree, 26, Nirmal Bag Society
Near Mukhtangan English School, Parvati, Pune 411009
Phone: 09890444795, Email: enrichcons@gmail.com

MAHARASHTRA ENERGY DEVELOPMENT AGENCY



Maharashtra Energy Development Agency

(A Government of Maharashtra undertaking)

2nd Floor, MHADA Commercial Complex, Opp. Tridal Nagar, Yerwada, Pune 411 006,
Ph No: 020-26614393/266144403

Email: eee@mahaurja.com, Web: www.mahaurja.com

ECN/2018-19/CR-05/4174

19th September, 2018

**CERTIFICATE OF REGISTRATION
FOR CLASS 'A'**

We hereby certify that, the firm having following particulars is registered with **MAHARASHTRA ENERGY DEVELOPMENT AGENCY (MEDA)** under given category as "Energy Planner & Energy Auditor" in Maharashtra for Energy Conservation Programme of MEDA.

Name and Address of the firm : **Enrich Consultants**
Yashashree, Plot No. 26, Nirmal Bag Society,
Near Mukhtangan English School,
Parvati, Pune - 411009.

Registration Category : Empanelled *Consultant for Energy Conservation Programme*

Registration Number : **MEDA/ECN/CR-05/2018-19/EA-03**

- Energy Conservation Programme intends to identify areas where wasteful use of energy occurs and to evaluate the scope for Energy Conservation and take concrete steps to achieve the evaluated energy savings.
- MEDA reserves the right to visit the firm at any time without giving any prior information and canceling the registration, if the information is found incorrect.
- This empanelment is valid till **31st March 2021** from the date of registration, to carry out energy audits under the Energy Conservation Programme
- The Director General, MEDA reserves the right to cancel the registration at any time without assigning any reasons thereof.


(Smita Kudarikar)
General Manager (EC)

Enrich Consultants

Yashashree, 26, Nirmal Bag Society,
Near Mukangan English School, Parvati, Pune 411 009
Tel: 09890444795 Email: enrichcons@gmail.com

Ref: EC/PES/MCASC/18-19/01

Date: 10/8/2019

CERTIFICATE

This is to certify that we have conducted Energy Audit at P.E.S. Modern College of Arts, Science & Commerce, Ganeshkhind, Pune in the year 2018-19.

The College has already adopted **Energy Efficient** practices like:

- Usage of Energy Efficient LED Fittings
- Usage of Energy Efficient BEE STAR Rated equipment
- Installation of **13 kW** Hybrid Roof Top Solar PV/Wind Power Plant.

We appreciate the support of Management, involvement of faculty members and students in the process of making the Energy Efficient & Green.

For Enrich Consultants,

A Y Mehendale,
Certified Energy Auditor
EA-8192

CONTENTS

No	Particulars	Page No
I	Acknowledgement	5
II	Executive Summary	6
III	Abbreviations	8
1	Introduction	9
2	Study of Connected Load	10
3	Study of Present Energy Consumption	15
4	Carbon Foot Printing	17
5	Study of Usage of Alternate Energy	19
6	Study of Usage of LED Lighting	20
7	Energy Conservation Proposal	22

ACKNOWLEDGEMENT

We at Enrich Consultants, Pune wish to express our sincere gratitude to the management of P.E.S. Modern College of Arts, Science & Commerce, Ganeshkhind, Pune for assigning the work of Energy Audit of Ganeshkhind campus for the Year: 2018-19.

We appreciate the co-operation and support extended to our team members during the entire tenure of field study.

We express our sincere thanks to

1. Prof. Dr. G. R. Ekbote, Chairman, Progressive Education Society
2. Prof. Dr. Sanjay S. Kharat, Principal
3. Prof. Dr. Mrs. Pallawi Bulakh, Faculty Member

We are also thankful to all other staff members who helped us during the field study.

EXECUTIVE SUMMARY

A Detailed Energy Audit of **Progressive Education Society's Modern College of Arts, Science & Commerce**, Ganeshkhind, Pune was entrusted to M/s. Enrich Consultants, Pune. Based On the field study analysis, we present the following points.

1. Progressive Education Society's Modern College of Arts, Science & Commerce uses Electrical Energy as the source of Energy for various equipment in the college campus.

2. Present Level of Energy Consumption:

No	Parameter /Value	Energy, kWh	Maximum Demand, kVA	Power Factor	CO ₂ Emissions, MT
1	Max	20388	97	0.96	16.31
2	Min	9290	73	0.916	7.43
3	Average	16590	84	0.927	13.27

3. Various measures adopted for Energy Conservation & renewable Energy:

1. Usage of LED tube lights
2. Usage of STAR Rated equipment
3. Maintenance of good power factor
4. Installation of **13 kWp Solar & Wind Hybrid** roof top plant.

4. Percentage of Usage of Alternate Energy:

The College has installed a Roof Top Hybrid Solar plus Wind Energy Plant. The percentage of usage of Alternate Energy to Annual Energy Requirement is **7.27 %**.

5. Percentage of Usage of LED Lighting:

The College has various Types of Light fittings, namely: LED, FTL & CFL. The percentage of Annual LED Lighting Usage to Annual Lighting requirement works out to be **32.33 %**.

6. Recommendation:

No	Recommendation	Annual Saving potential, kWh/Annum	Annual Monetary saving potential, Rs	Investment required, Rs	Simple payback period, Months
1	Replacement of 269 Nos T-8 fittings by 20 W LED fittings	12912	142032	94150	8

2	Total	12912	142032	94150	8
----------	--------------	--------------	---------------	--------------	----------

7. Notes & Assumptions:

1. **1 Unit (kWh)** of Electrical Energy releases **0.8 Kg of CO₂** into atmosphere
2. Daily working hours- **8 Nos.**
3. Annual working Days-**300 Nos**
4. Rate of Electrical Energy is considered as **Rs 11/ per kWh**
5. Daily Energy Generated by **13 kW** Hybrid Plant as **4 kWh.**

ABBREVIATIONS

AC	:	Air conditioner
PES	:	Progressive Education Society
CFL	:	Compact Fluorescent Lamp
FTL	:	Fluorescent Tube Light
LED	:	Light Emitting Diode
kWh	:	kilo-Watt Hour
Qty	:	Quantity
W	:	Watt
kW	:	Kilo Watt
PF	:	Power Factor
M D	:	Maximum Demand
PC	:	Personal Computer
MSEDCL	:	Maharashtra State Electricity Distribution Company Ltd

CHAPTER 1 INTRODUCTION

1.1 Objectives:

1. To study present level of Energy Consumption
2. To Study the present CO₂ emissions
3. To assess the various equipment/facilities from Energy efficiency aspect
4. To study Scope for usage of Renewable Energy
5. To study various measures to reduce the Energy Consumption

1.2 General Details of College: Table No-1:

No	Head	Particulars
1	Name of Institution	PES Modern College of Arts, Commerce & Science
2	Address	Ganeshkhind, Pune
3	Affiliation	Savitribai Phule Pune University

CHAPTER-II

STUDY OF CONNECTED LOAD

In this chapter, we present the details of various Electrical loads as under

2.1.1 Details of Tube Light Fittings & Fans at various locations: Table No-2:

No	Location	LED 5W	LED 9W	LED 15W	LED 22W	T-8 FTL	CFL 18W	FAN	WALL FAN	PC	AC
1	IQAC Cell			4					1	1	1
2	Student Section		14	33	1			4	1	12	4
3	Principal Office			13					3	2	1
4	Vice Principal Office		4					1		1	
5	Dept of Computer Science										
6	Vice Principal	5	9					4		4	
7	Staff Room		13		2			3		1	
8	LAB I			9	4					36	2
9	LAB II			13					4	51	
10	LAB III			8	1	1			1	21	1
11	LAB IV				2	4		2		22	
12	Server Room			2						2	2
13	HOD CABBIN				6			1		1	1
14	Placement Cell				2			1			
15	Deptt of Elect Science										
16	LAB I			11				4			
17	LAB II			9				3		1	
18	LAB III			9				3		19	
19	Mobile App Company	6							1	2	
20	Staff Room			5				3		2	
21	DEPT.OF STATISTICS				3	2		4		2	
22	DEPT.OF MATHEMATICS										
23	Staff Room	6						1		6	
24	HOD CABIN	6						1		1	
25	Computer Lab			10		1		1	2	20	

26	DEPT.OF PHYSICS									
27	HOD CABIN		5					2		6
28	LAB I		10					3		
29	LAB II		5					2		6
30	DEPT.OF CHEMISTRY									
31	HOD Cabin					2		1		1
32	LAB I					16		2		
33	LAB II					7		3		4
34	LAB III					8				
35	LAB IV					13		4		
36	Staff Room				1	12		2		1
37	2ND LOOR									
38	Class room- A1-A4					34		24		
39	Wing				1	4				
40	DEPT.OF MICROLOGY									
41	UG LAB					12		7		
42	PG LAB					4		8		
43	Instrument Room					6		2		4
44	DEPT.OF ZOOLOGY					14		3		2
45	DEPT.OF BIOTECHNOLOY(PG)				2	13		5		21
46	3RD FLOOR									
47	Class Rooms- A5-A9		70			14		41		
48	DEPT.OF BIOTECHNOLOGY(UG)					24		10		6
49	DEPT.OF Botany					10		6		3
50	Deptt of Physical Education				4	3		2	1	2
51	BUILDING 2									
52	DEPT.OF HISTORY									
53	Staff Room	9						2		
54	ROOM C2-C3			3	4	5		4		1


55	Corridor					1					
56	DEPT.OF BBA(CA)										
57	Lab					10		8		60	
58	Class Room- N1-N2				8			4			
59	Staff Room				1		1	1		1	
60	Corridor				3						
61	FIRST FLOOR										
62	Class Rooms- C4-C7				4	10		11		22	
63	Deptt of Zoology					2					
64	2ND FLOOR										
65	Dept of Social Science				3			1		2	
66	Class Rooms C8-C11				1	16		8			
67	BBA CA F.Y.				9			5			
68	THIRD FLOOR										
69	Deptt of Geography										
70	Competitive Exam Cell			2					1	1	
71	HOD Cabin			8					2	1	
72	Deptt of Economics			2		1			1	1	
73	Lecture Hall			12					6		
74	FOURTH FLOOR										
75	Class Rooms- C12-C15			24		4		20			
76	Counselling Hall		13						7	1	
77	GYM					7			4		
78	Class Rooms- L1-L3					9		9			
79	Maintenance Rooms			3	2						
80	DEPT.OF B.VOC.	7	10	8				7		2	
81	Library				1		102	12	1	35	
82	Canteen				13			9			
83	Total	39	153	188	78	269	103	264	36	390	13

2.2 Details of Overall Connected Load: Table No-3:

No	Equipment	Qty	Load, W/Unit	Load, kW
1	5W LED	39	5	0.20
2	9W LED	144	9	1.30
3	15W LED	188	15	2.82
4	22W LED	78	22	1.72
5	T-8 FTL	269	40	10.76
6	CFL	103	18	1.85
7	Ceiling Fan	164	65	10.66
8	WALL FAN	38	65	2.47
9	PC	390	150	58.50
10	AC(Non STAR)	14	2325	32.55
11	AC(2STAR)	2	1987.5	3.98
12	Printer	32	150	4.80
13	Projector	17	150	2.55
14	Xerox Machine	4	700	2.80
15	Exhaust Fan	23	40	0.92
16	Others	10	100	1.00
17	Total			139

2.3 Details of Connected Load:

We present the above Data in a PIE Chart as under.

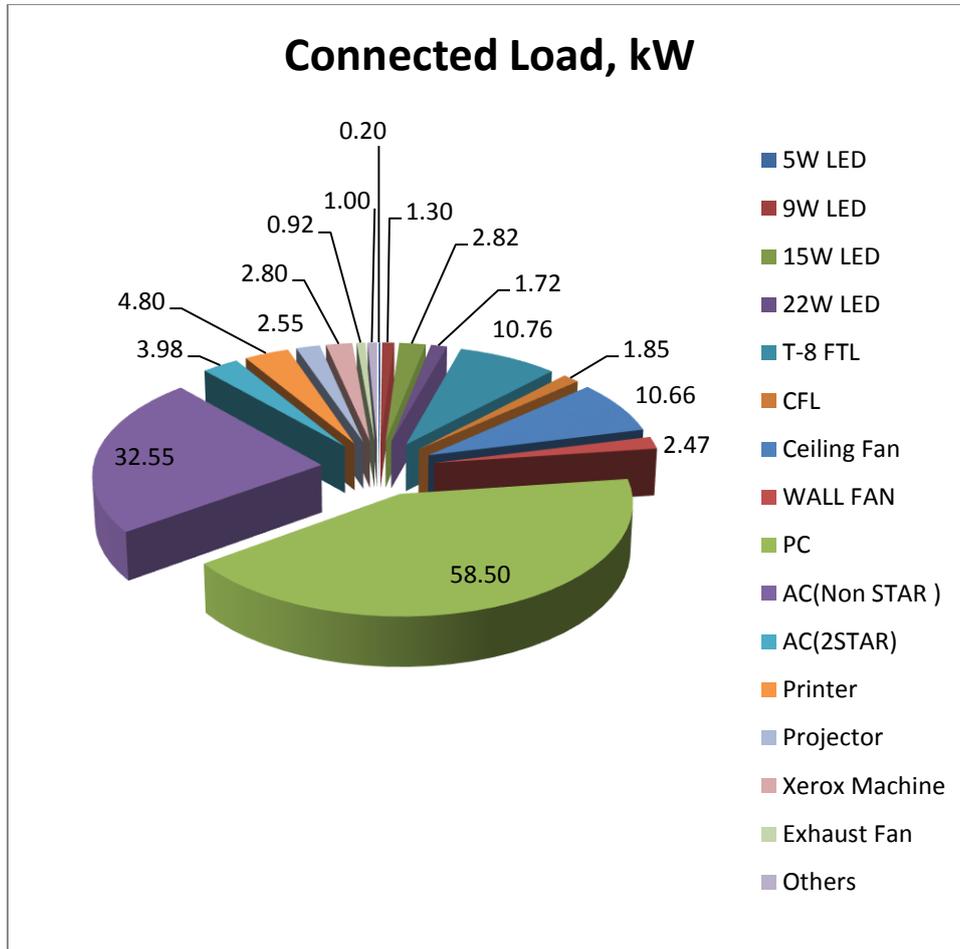

CHAPTER-III STUDY OF PRESENT ENERGY CONSUMPTION

In this chapter, we present the analysis of last year Electricity Bills

Table No-4: Electrical Bill Analysis- 2018-19:

No	Month	Energy Consumed kWh	Maximum Demand, kVA	Power Factor	CO ₂ Emission MT
1	Aug-18	19866	92	0.916	15.89
2	Sep-18	17724	96	0.919	14.18
3	Oct-18	18370	87	0.925	14.70
4	Nov-18	9290	74	0.927	7.43
5	Dec-18	13716	74	0.93	10.97
6	Jan-19	14668	74	0.92	11.73
7	Feb-19	16002	86	0.919	12.80
8	Mar-19	20388	91	0.927	16.31
9	Apr-19	19700	97	0.917	15.76
10	May-19	15536	75	0.921	12.43
11	Jun-19	15464	73	0.94	12.37
12	Jul-19	18352	94	0.96	14.68
13	Maximum	20388	97	0.96	16.31
14	Minimum	9290	73	0.916	7.43
15	Average	16590	84	0.928	13.27

Chart No-2: Monthly Unit Consumption (kWh) Variation:

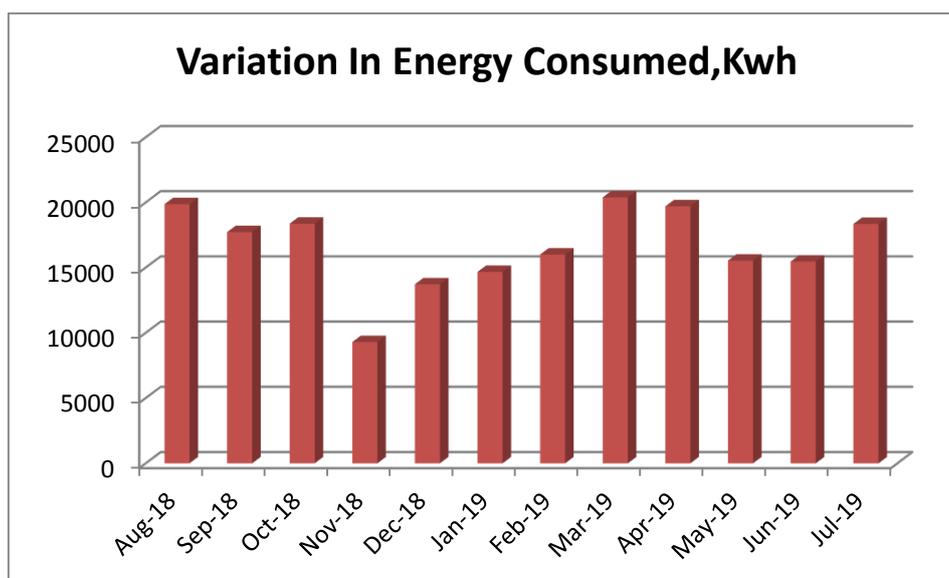


Chart No-3: Monthly Variation in Maximum Demand, kVA:


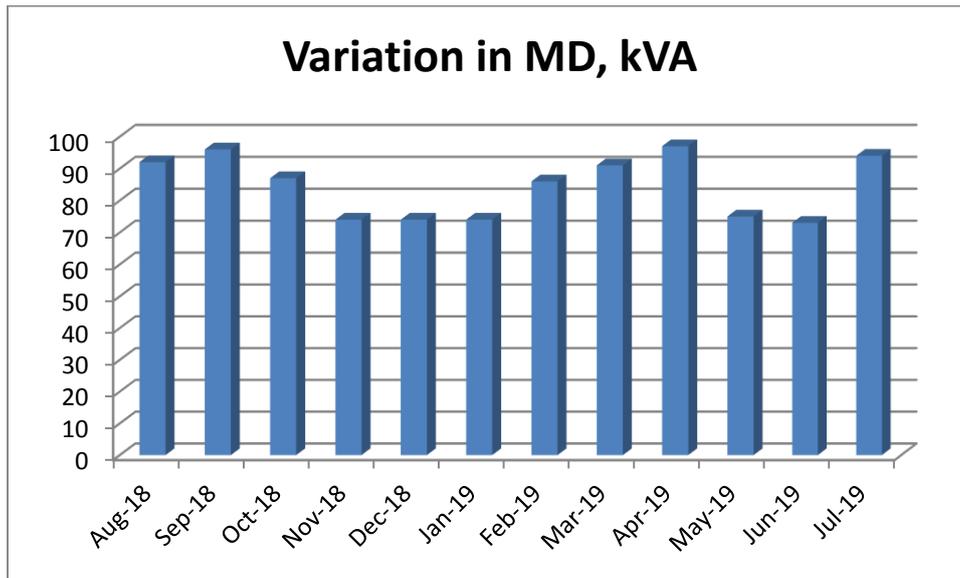


Chart No-4: Monthly Variation in Power Factor:

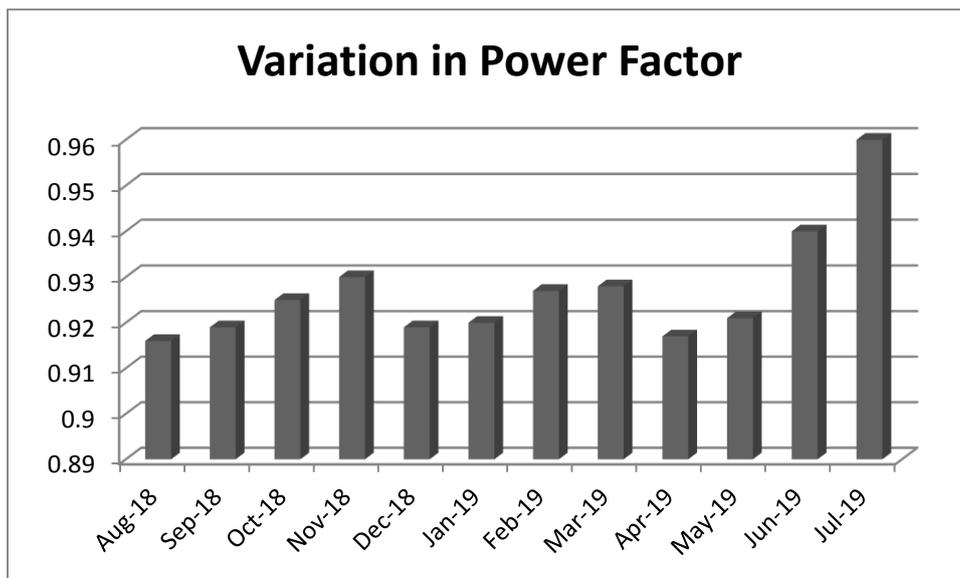

CHAPTER IV

CARBON FOOTPRINTING

4.1 A Carbon Foot print is defined as the Total Greenhouse Gas emissions (CO₂ emissions), emitted due to various activities. In this we compute the emissions of Carbon-Di-Oxide, by usage of the various form of Electrical Energy used by the College for performing its day to day activities

4.2 Basis for computation of CO₂ Emissions:

The basis of Calculation for CO₂ emissions due to Electrical Energy is as under

- 1 Unit (kWh) of Electrical Energy releases **0.8 Kg of CO₂** into atmosphere

Based on the above Data we compute the CO₂ emissions which are being released in to the atmosphere by the College due to its Day to Day operations


We herewith furnish the details of various forms of Energy consumption as under

Table No-5: Month wise Consumption of Electrical Energy & CO₂ Emissions:

No	Month	Energy Consumed kWh	CO ₂ Emission MT
1	Aug-18	19866	15.89
2	Sep-18	17724	14.18
3	Oct-18	18370	14.70
4	Nov-18	9290	7.43
5	Dec-18	13716	10.97
6	Jan-19	14668	11.73
7	Feb-19	16002	12.80
8	Mar-19	20388	16.31
9	Apr-19	19700	15.76
10	May-19	15536	12.43
11	Jun-19	15464	12.37
12	Jul-19	18352	14.68
13	Total	199076	159.26
13	Maximum	20388	16.31
14	Minimum	9290	7.43
15	Average	16590	13.27

In the following Chart we present the CO₂ emissions due to usage of Electrical Energy.

4.3 Representation of Month wise CO₂ emissions: Chart No-5:

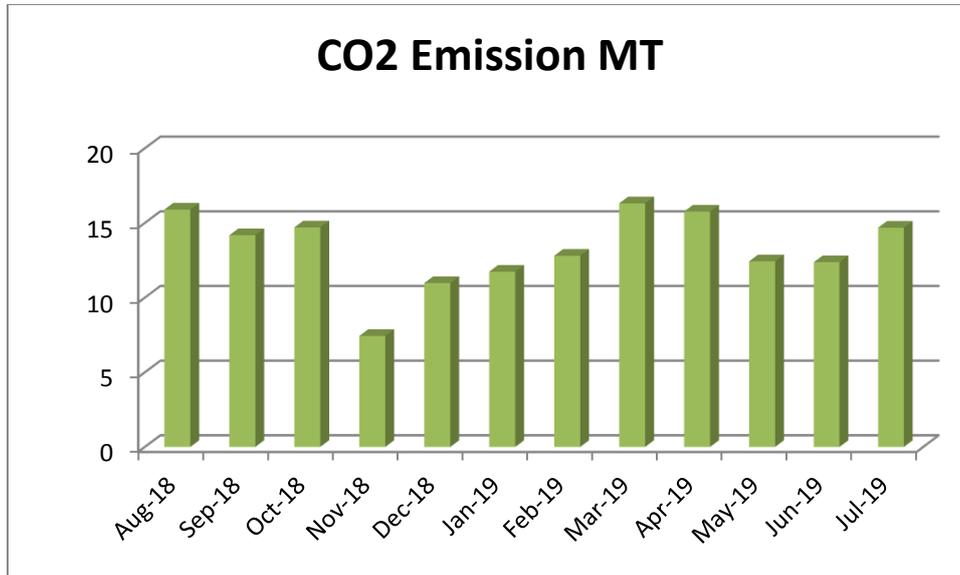

CHAPTER V

STUDY OF USAGE OF ALTERNATE ENERGY

5.1 In this Chapter, we compute the percentage of Usage of Alternate/Renewable Energy to Annual Energy Requirement of the College. The College has installed Roof Top Solar Wind Hybrid System of Capacity **13 kW**.

5.2 Table No-6: Computation of % Usage of Alternate Energy to Annual Energy Requirement:

No	Particulars	Value	Unit
1	Annual Energy Purchased from MSEDCL	199076	kWh
2	Energy Generated by Roof Top Hybrid System per Day	52	kWh
3	Annual Generation Days	300	Nos
4	Annual Energy Generated = (2) * (3)	15600	kWh
5	Total Energy Requirement of College= (1) + (4)	214676	kWh/Annum
6	% of Usage of Alternate Energy to Annual Energy Requirement = (4) * 100 / (5)	7.27	%

Photograph of Hybrid Solar/Wind Power Generation Plant:



CHAPTER VI

STUDY OF USAGE OF LED LIGHTING

In this Chapter, we compute the percentage of Annual Lighting Energy requirement met by LED Lighting.

Table No-7: Calculation of % Annual Usage of LED Lighting:

No	Particulars	Value	Unit
1	Quantity of 5 W LED Fittings	39	Nos
2	Load/Unit of 5 W LED Fittings	5	W/Unit
3	Total Load of 39 No of fittings	0.195	kW
4	Quantity of 9 W LED Fittings	144	Nos
5	Load/Unit of 9 W LED Fittings	9	W/Unit
6	Total Load of 144 Nos of fittings	1.296	kW
7	Quantity of 15 W LED Fittings	188	Nos
8	Load/Unit of 15 W LED Fittings	15	W/Unit
9	Total Load of No 188 of fittings	2.82	kW
10	Quantity of 22 W LED Fittings	78	Nos
11	Load/Unit of 22 W LED Fittings	22	W/Unit
12	Total Load of 78 Nos of fittings	1.716	kW
13	Quantity of CFL Fittings	103	Nos
14	Load/Unit of CFL Fittings	18	W/Unit
15	Total Load of 103 Nos of fittings	1.854	kW
16	Quantity of T-8 Fittings	269	Nos
17	Load/Unit of T-8 Fittings	40	W/Unit
18	Total Load of 269 No of fittings	10.76	kW
19	Total LED Lighting Load = 3+6+9+12	6.027	kW
20	Total Lighting Load = 3+6+9+12+15+18	18.641	kW
21	Daily Usage Period	6	Hrs/Day
22	Annual Working Days	250	Nos

23	Annual Total Lighting Energy Requirement= $20 \times 21 \times 22$	27961.5	kWh/Annum
24	Annual LED Lighting Requirement= $1 \times 21 \times 22$	9040.5	kWh/Annum
25	% of Annual LED Lighting Usage to Total Lighting Requirement=$24 \times 100 / 23$	32.33	%

CHAPTER VII

ENERGY CONSERVATION PROPOSALS

7.1: Replacement of 269 Nos T-8 FTL fittings by 20 W LED Fittings:

During the Audit it was observed that there are about **269 Nos** T-8 FTL fittings in the College facility. It is recommended to replace these old fittings by 20 W LED fittings.

In the following Table, we present the saving potential, investment required and payback analysis.

No	Particulars	Value	Unit
1	Present Qty of T-8 fittings	269	Nos
2	Energy Demand of T-8 fitting	40	W/Unit
3	Energy Demand of 20 W LED fitting	20	W/Unit
4	Reduction in demand	20	W/Unit
5	Average Daily Usage period	8	Hrs/Day
6	Daily saving in Energy	43.04	kWh/Day
7	Annual Working Days	300	Nos
8	Annual Energy Saving possible	12912	kWh/Annum
9	Rate of Electrical Energy	11	Rs/kWh
10	Annual Monetary saving	142032	Rs/Annum
11	Rate of 20 W LED tube light	350	Rs/unit
12	Investment required for 269 tubes	94150	Rs lump sum
13	Simple Payback period	8	Months

7.2 Summary of Saving:

No	Recommendation	Annual Saving potential, kWh/Annum	Annual Monetary saving potential, Rs	Investment required, Rs	Simple payback period, Months
1	Replacement of 269 Nos T-8 fittings by 20 W LED fittings	12912	142032	94150	8
2	Total	12912	142032	94150	8